


DGT-BATCH1U

SINGLE PRODUCT DOSAGE IN UNLOADING FUNCTIONING

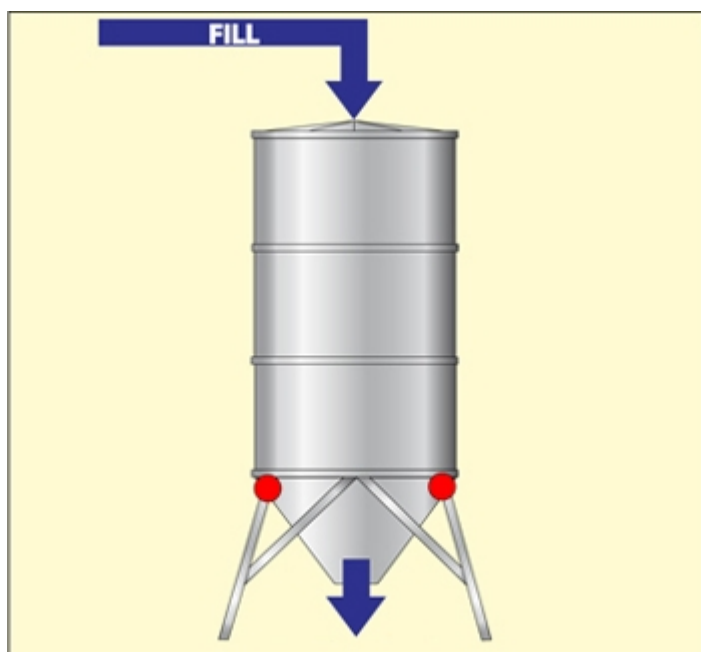

Configuration which allows to manage a dosage system in unloading of a single product, useful for dividing the quantity of materials of equal weight or extract precise quantities from the silo, with management of the reloading.

**The best solution
for advanced industrial
applications**

DATABASES

- Database of 40 formulas with target, speed change threshold, flight, +/- tolerance.

KEYBOARD FUNCTIONS

- START / RESTART dosage, PAUSE / RESET cycle and introduction / selection formula.
- Quick switch of the dosage target, through a dedicated key.
- Quick introduction and selection of the dosage data, only for models with numeric keyboard

I/O FUNCTIONS

- Serial communication protocol for programming the formulas, the products and managing the cycle.
- START / RESTART dosage, PAUSE / RESET cycle through external inputs.
- Formula selection through 2 external inputs (only for models with 4 inputs).
- Dual dosage speed (approximate and fine), through any available contacts or analogue output (in the "AN" models).
- "Fine" dosage contact active either constantly or intermittently (jogging).
- Automatic management of the reloading of the silo using a dedicated contact.
- Indication of weight within tolerance, out of tolerance, finished dosage, or alarm through any dedicated contacts.
- Analogue output (only for "AN" models) proportional to the weight or to the dosage speed.


DOSAGE FUNCTIONS

- Automatic dosage in unloading.
- Automatic printing of the dosage data.
- Storage and printing of the consumptions. Printouts may be quickly recalled from the keyboard.
- Automatic correction of the flight weight.
- Repetitions of the programmable dosage cycles; infinite cycle function.
- Tolerance test on the dosed weight, with guided correction on display.
- Control of the maximum dosage time.
- Alarms indication on display.

FUNCTIONING OF THE DOSAGE IN UNLOADING

- 1. Once the dosage start command is received, the instrument:
 - verifies that the quantity of material is sufficient to execute the programmed dosage cycle and that the weight is stable,
 - executes the automatic tare and the enabling of the automation through its dedicated outputs: the dosages start at maximum speed.
- 2. Once the speed switch threshold is reached, the dosage slows down through its dedicated output.
- 3. When the TARGET is reached and the configured flight weight is missing, it disables the dosage output, and then it waits (for the configured time) for dropping the material.
- 4. Tolerance test on the dosed weight.
- 5. Storage of the formula consumptions and increment of the dosed general total.
- 6. Waits for the start of the new dosage or automatically restarts with the following cycle.

DETAIL 1

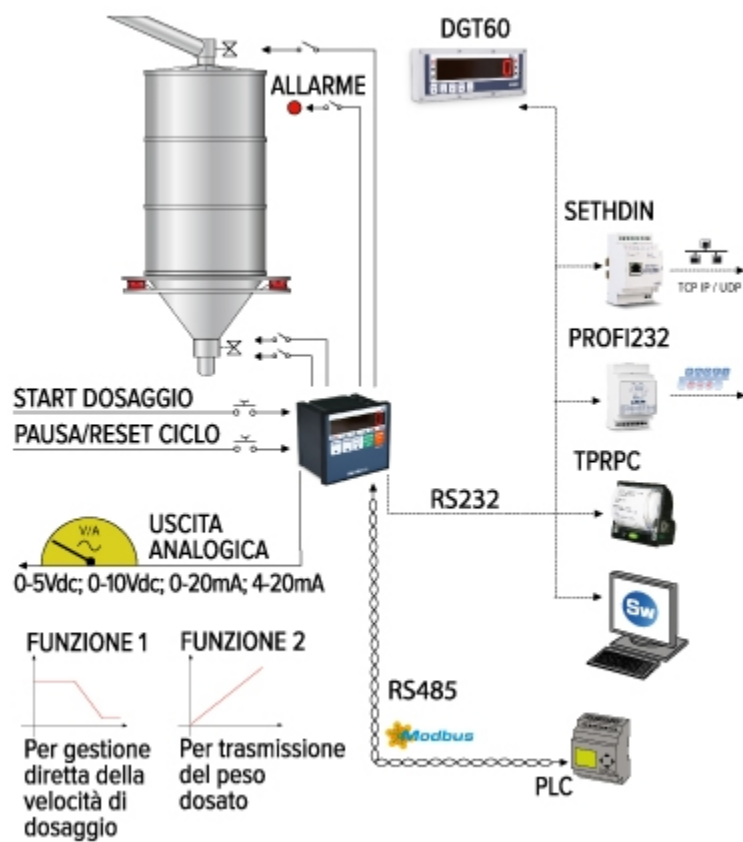

Example of dosage system for discharging with the DGTQF



www.diniargeo.com

“YOUR WORLDWIDE PARTNER FOR WEIGHING,”

DINI ARGEO
FRANCE sarl
France

DINI ARGEO
GMBH
Germany

DINI ARGEO
UK Ltd
United Kingdom

DINI ARGEO WEIGHING
INSTRUMENTS Ltd
China

DINI ARGEO
OCEANIA
Australia



COMPANY HEADQUARTERS

Via Della Fisica, 20
41042 Spezzano di Fiorano Modena • Italy
Tel. +39.0536 843418

SERVICE ASSISTANCE

Via Dell'Elettronica, 15
41042 Spezzano di Fiorano Modena • Italy
Tel. +39.0536 921784

SALES AND TECHNICAL ASSISTANCE SERVICE